


## INSTALLATIONSEXEMPEL KANALFLÄKT DZR-EX:

### DZR B Ex e

#### Installation in ventilation duct

- Recommended distance to the next element is a minimum of 3-5 x the duct diameter "D"
- If the cross-section narrows: Duct diameter "d" = max. 0.75 x the duct diameter "D", angle of inclination 6-8°

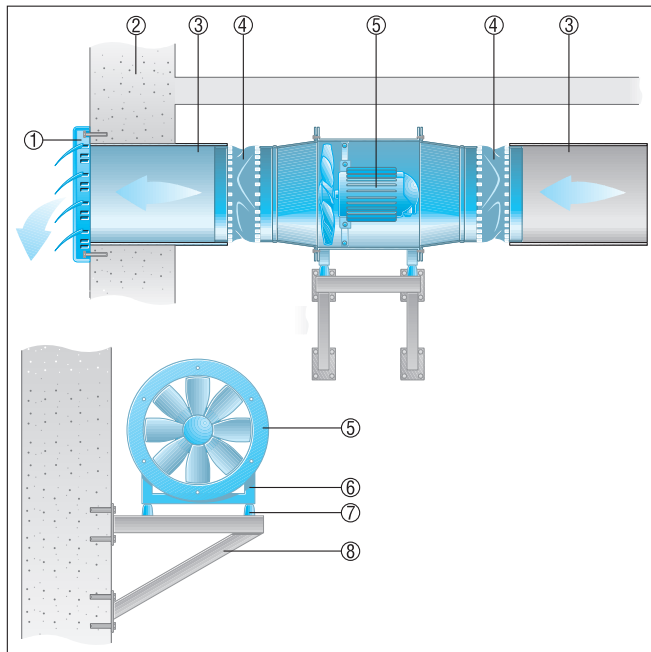

- ① Shutter, airstream-operated
- ② External wall
- ③ Ventilation duct, to be supplied by the customer
- ④ ELA..-Ex flexible coupling
- ⑤ Fans
- ⑥ FU mounting feet (1 set)
- ⑦ GP vibration damper
- ⑧ Bracket, to be supplied by the customer

För fast installation i rörledningar med spirorör som passar till utrustningstypen (nominell diameter).  
Montering på vägg, tak eller konsol med tillräcklig bärighet.

- Valfritt monteringsläge.
- Omkopplingsbar mellan ventilation och avluftning.
- För att undvika vibrationsöverföring till rörsystemet rekommenderar vi att elastiska anslutningsrör av typ EL-Ex och ELAEx, monteringsfot FU samt vibrationsdämpare GP